



3KVA(1:1) => Model -HP3KL Online UPS System MTBF-MTTR- AVAILABILITY & AFR

| | | | |
|-------------|---|------------------------|----------------------------------|
| MTBF | = | Hours in a Year AFR | Mean Time Between failure |
|-------------|---|------------------------|----------------------------------|

Failures are defined as critical load drops caused by anything, including human error.

During the sample period, hundred failures were reported. Of those, So, based on the definition of failure ,hundred failures are used in the calculation that follows. The failed products were received, diagnosed, and repaired prior to the AFR calculation.

AFR is Calculated As

| | | |
|------------|---|---|
| AFR | = | 100failures X (52 weeks per year /24 weeks in 3000 |
|------------|---|---|

| | |
|---|------------------|
| = | 100x2.17 3000 |
|---|------------------|

| | |
|---|-------|
| = | 0.072 |
|---|-------|

| | | | |
|-------------|---|---------------|--------------|
| MTBF | = | 8760 0.072 | hours |
|-------------|---|---------------|--------------|

| | | | |
|-------------|---|--------|--------------|
| MTBF | = | 121667 | hours |
|-------------|---|--------|--------------|

| | | | |
|-------------|---|-----------|--------------|
| MTBF | = | 14 | Years |
|-------------|---|-----------|--------------|



| | | |
|-------------|---|----------------|
| MTTR | = | 4 hours |
|-------------|---|----------------|

| | | |
|---------------------|---|-------------------|
| Availability | = | MTBF MTBF+MTTR |
|---------------------|---|-------------------|

| | | |
|---------------------|---|----------------------|
| Availability | = | 121667 (121667+4) |
|---------------------|---|----------------------|

| | | |
|---------------------|---|------------------|
| Availability | = | 121667 121671 |
|---------------------|---|------------------|

| | | |
|---------------------|---|-------------|
| Availability | = | 0.999967124 |
|---------------------|---|-------------|

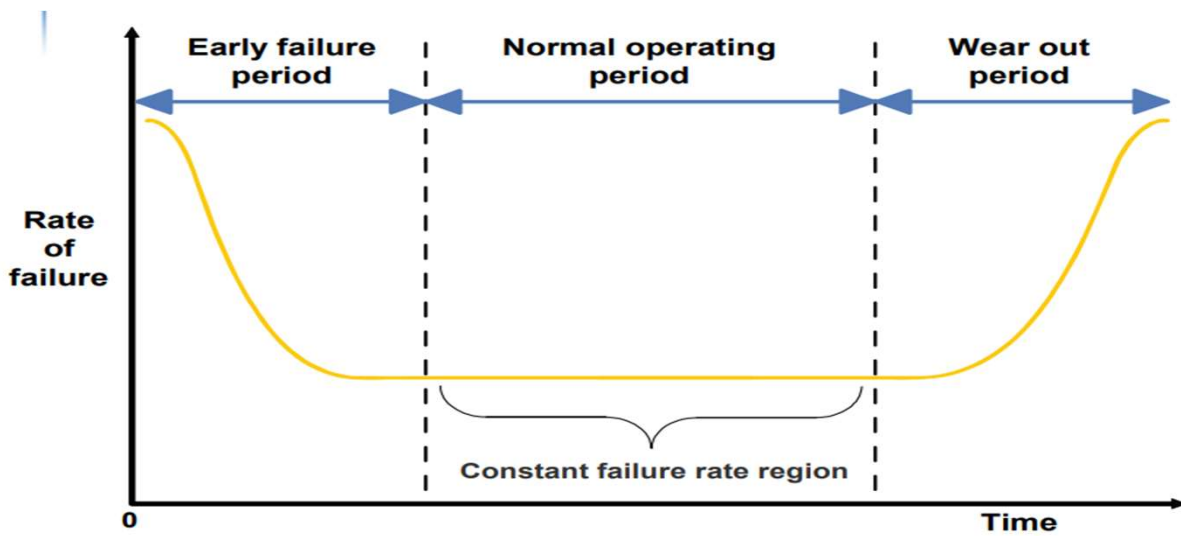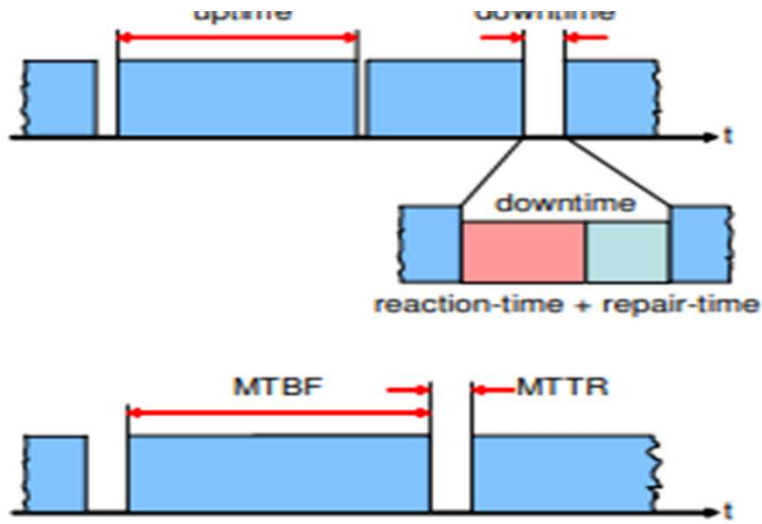

Regd. Office: 230, S.N. Roy Road, Kolkata 700038

CIN- U31200WB2004PLC098363

H.O.: 97, Raja Rammohan Roy Road, Kolkata 700041

Phone: +91-33-6518-1192/3201-7233, Fax: +91-33-2400-1420, Email: switching@avoups.com, Website: www.switchingavo.com